

Basin Mixer

Installation Guide

Technical Specifications:

Operating Pressure:

Min: 150kPa/1.5bar

Max: 500kPa/5bar*

Optimum: 150kPa/1.5bar - 500kPa/5bar

Operating Temperature:

Hot: Max 80°C*

Cold: Min 5°C

Inlet Connections:


All 1/2" BSP

USE PARALLEL FITTINGS ONLY

** This product complies with the Lead Free requirements of the National Construction Code Volume Three.*

** New Regulation :-500 kPa maximum static pressure at any outlet within a building. (Ref: AS/NZS 3500.1)*

** Regional specific regulations apply. Please refer to your warranty statement at www.methven.com*

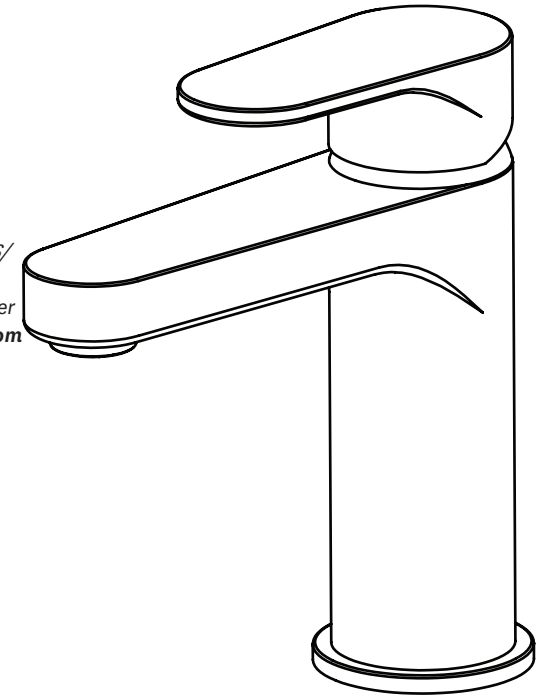

Care and Cleaning:

Never use abrasives or abrasive cleaning agents to clean this product. Clean regularly with contamination free warm soapy water and a damp soft cloth.

Methven warrants this product against manufacturing defects and that it is suitable for use under the general operating conditions specified in this instruction sheet. However, regional regulations apply and may affect your warranty. Please refer to www.methven.com or call customer service for full details.

New Zealand
0800 804 222

Australia
1300 638 483

UK
0800 195 1602

439800


ISSUE D,
August 2024

METHVEN
www.methven.com

IMPORTANT: Please read all of the instructions before installation.

General:

- Methven recommends this product is installed by a licensed plumber in compliance with all relevant regional regulations.
- Do not hydrostatic test the installation with this mixer installed. Damage to the ceramic cartridge may occur.
- All pipe work must be thoroughly flushed prior to the installation of the mixer.
- In-line filters must be fitted on both hot and cold supplies to prevent foreign particles damaging the ceramic cartridge.
- Do not remove the ceramic cartridge from the mixer when installing.
- After installation all connections must be checked for leaks.
- All outlets used primarily for personal hygiene shall deliver water at a safe temperature as per regional regulations.
- This mixer is not recommended for use in uncontrolled heating systems such as wet-backs or solar heating units unless a suitable tempering valve is fitted.
- If limited water flow is experienced, locate aerator and filter washers and clean away foreign material as required.
- It is the responsibility of the installer to ensure a waterproof seal is achieved between the product and mounting surface. If in doubt about the quality of the seal, remove the product and reinstall.
- Ensure flow controller has been tightened in mixer outlet to prevent the removal by hand.

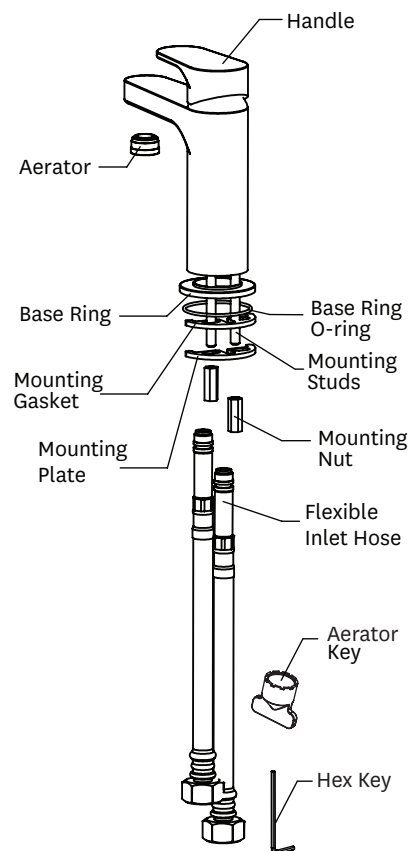

IMPORTANT: Before you begin, turn off the water supply. It is recommended to fit isolation valves to both the hot and cold supply.

Installation:



1. Cut a single 35mm diameter hole into the mounting surface or use existing hole.
2. Insert o-ring provided into the groove in the bottom of the base ring.
3. Unscrew mounting nuts and remove mounting plate, mounting gasket and one flexible inlet hose if necessary.
4. Place base ring over hole ensuring that the o-ring remains in place.
5. Feed hose and mounting studs through the base ring and hole in the mounting surface.
6. Screw second hose into base of mixer if removed in step 3.
7. Slide mounting gasket and mounting plate onto mounting studs.
8. Position the mixer as desired.
9. Tighten mixer body to the mounting surface using the mounting nuts supplied.

Please Note:

Make sure the o-ring in the base ring seals completely around the hole in the mounting surface.

10. Connect the ½" BSP Female hose fittings to the hot and cold supplies. Turn on the water supply and check carefully for leaks. Retighten joints if necessary.

Do not stretch or twist hose

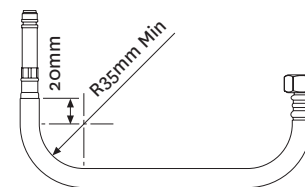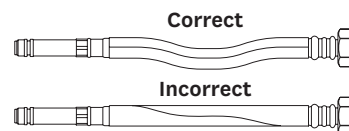

DO NOT crush
Hose or swaged
Ends